

October 2015

# Mycronic SMD Tower™ 6150-7 Specification

---



# Specification Mycronic SMD Tower 6150-7

## CAPABILITY

RANDOM ACCESS STORAGE SYSTEM FOR SMD REELS	
Reel sizes	8 to 24 mm (4"/100 mm reels) 8 to 24 mm (7"/180 mm reels) 8 to 56 mm (13"/330 mm reels) 8 to 56 mm (15"/380 mm reels)
Freely configurable and expandable	
Access time	5 reels/minutes typ.

## CAPACITY

CASSETTE CAPACITY	
CASSETTE TYPE	NUMBER
4" - 7"	35
13"	24
15"	11

MAXIMUM REEL			
REEL WIDTH	CASSETTES / SMD TOWER	REELS / CASSETTE	NUMBER OF REELS
8 mm / 4" - 7"	35	28	980

MAXIMUM TRAY			
CASSETTE WIDTH	CASSETTES / SMD TOWER	TRAY BOXES / CASSETTE	NUMBER OF TRAY BOXES
44 mm / 13"	35	25	875

STANDARD CONFIGURATION				
REEL WIDTH	CASSETTES / SMD TOWER	REELS / CASSETTE	NUMBER OF REELS	TOTAL
8 mm / 4" - 7"	2	14	56	418
8 mm / 13"	5	14	70	
8 mm / 15"	0	14	0	
12 mm / 4" - 7"	2	12	48	
12 mm / 13"	3	12	36	
12 mm / 15"	2	12	24	
16 mm / 4" - 7"	2	10	40	
16 mm / 13"	3	10	30	
16 mm / 15"	1	10	10	
24 mm / 4" - 7"	0	8	0	
24 mm / 13"	3	8	24	
24 mm / 15"	3	8	24	
32 mm / 13"	3	7	21	
32 mm / 15"	3	7	21	
44 mm / 13"	1	5	5	
44 mm / 15"	1	5	5	
56 mm / 13"	0	4	0	
56 mm / 15"	1	4	4	

## CASSETTES

CASSETTES AVAILABLE			
REEL WIDTH	REEL DIAMETERS		
	4" - 7"	13" <sup>(1)</sup>	15"
8 mm	•	•	•
12 mm	•	•	•
16 mm	•	•	•
24 mm	•	•	•
32 mm		•	•
44 mm		•	•
56 mm		•	•

(1) Smaller reels can be stored in a larger cassette.

## SOFTWARE

SOFTWARE FUNCTIONS		
	STANDARD MODE	MYCENTER MODE
Component management	•	(2)
Stock monitoring	•	(2)
External communication protocol	•	•
User Access System	•	•
Traceability	•	•
Job preparation	•	(2)
Barcoding	•	(2)
Data import/Export function	•	(2)
Inventory function	•	(2)
Component allocation	•	

(2) Handled by MYCenter software.

## ACCESSORY

DRY AIR UNIT FREY FND 3.0 F-DP	
Flow rate, max	(in) 24 m³/h, (out) 20 m³/h
Flow rate, type	3 m³/h
Air supply	class 4 (ISO 8573-1) or better
Operating pressure	5-10 bar
Power supply	115/230 V, 50/60 Hz, 18W
Dimension (W x D x H)	330 mm x 270 mm x 840 mm (13.0" x 10.6" x 33.1")

## MISCELLANEOUS


### INSTALLATION REQUIREMENTS

Weight	340 kg / 750 lbs
Power requirements	Single phase AC 300 VA
Voltage	110 – 240 V, 50/60 Hz
Ambient temperature	+18 to +35 °C (65 to 95 °F), < 95% RH non condensing

## DIMENSIONS

in mm.

### Mycronic SMD Tower 6150-7

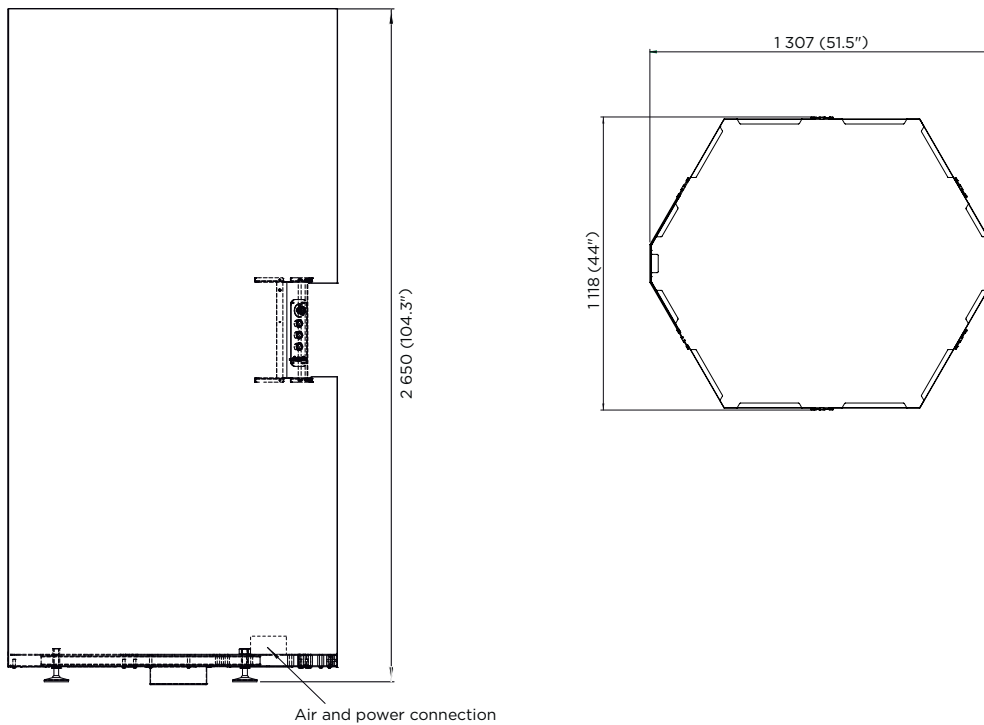

SWEDEN  
Mycronic AB  
PO Box 3141  
Nytorpsvägen 9  
SE-183 03 Täby  
Sweden  
Tel: +46 8 638 52 00  
Fax: +46 8 638 52 90

GERMANY  
Mycronic GmbH  
Tel: +49 89 4524248-0  
Fax: +49 89 4524248-80  
  
UK  
Mycronic Ltd.  
Tel: +44 1202 723 585  
Fax: +44 1202 723 269

FRANCE  
Mycronic S.A.S.  
Tel: +33 1 41 80 15 80  
Fax: +33 1 46 86 77 89  
  
NETHERLANDS  
Mycronic B.V.  
Tel: +31 402 62 06 67  
Fax: +31 402 62 06 68

USA  
Mycronic Inc.  
Tel: +1 978 948 6919  
Fax: +1 978 948 6915  
  
SOUTH KOREA  
Mycronic Co. Ltd.  
Tel: +82 31 387 5111  
Fax: +82 31 388 0087

CHINA  
Mycronic Co., Ltd.  
Tel: +86 21 3252 3785/86  
Fax: +86 21 3252 3780  
  
SINGAPORE  
Mycronic Pte Ltd.  
Tel: +65 6281 7997  
Fax: +65 6281 7667

JAPAN  
Mycronic Technologies  
Corporation  
Tel: +81 42 354 1320  
Fax: +81 42 354 1321

[www.mycronic.com](http://www.mycronic.com)

Specifications are subject to change without notice.  
Mycronic, MYDATA, MYDATA automation and MY: MY100, MY100DX, MY100SX, MY100LX, MY100e, MY100HXe, MY100DXe, MY100Sxe, MY100LXe, MY200, MY200HX, MY200DX, MY200SX, MY200LX, MY500, MY600 and MYSynergy; T3, T4, T5 and T6; HYDRA Speedmount, Midas, ISiC; Agilis, Agilis Linear Magazine (ALM), Agilis Linear Magazine Flex (ALM FLEX), Agilis Stick Magazine (ASM), Mycronic Tray Exchanger (TEX), Mycronic Tape Magazine (TM), Mycronic Tray Wagon Magazine (TWM); Mycronic Dip unit (DPU); Mycronic Standard Vision System (SVS), Mycronic Dual Vision System (DVS), Mycronic Linescan Vision System (LVS), Mycronic HYDRA Vision System (HVS); Mycronic Assembly Process Management (APM) including: JPSys, TPSys, MYLabel, MYPlan, MYCenter, MYTrace, MYCam, FlowLine and Cad Conversion are registered trademarks or trademarks of Mycronic AB. Mycronic is ISO 9001:2008 certified.

# MYCRONIC